

Submittal Data Sheet

Project Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____

Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

Performance

Indoor Unit Model No: FTXS15HVJU
 Cooling Capacity (Btu/hr): 15000
 Sensible Capacity (Btu/hr): 9600
 Cooling Input Power (kW): 0.04
 Heating Capacity (Btu/hr): 18000
 Heating Input Power (kW): 0.04
 Nominal Ext Static Pressure (inH₂O): 0
 Max Ext Static Pressure (inH₂O): 0

Indoor Unit Type: Wall Mounted
 Cooling Nominal Conditions Indoor: 80°F DB/67°F WB
 Outdoor: 95°F DB/75°F WB
 Heating Nominal Conditions Indoor: 70°F DB/60°F WB
 Outdoor: 47°F DB/43°F WB
 Nominal Piping Length 25
 Nominal Height Separation 0

Indoor Unit Details

Power Supply (V/Hz/Ph): 208-230/60/1ph
 Power Supply Connections: L1, L2, Ground
 Min. Circuit Amps MCA (A): data book
 Max. Fusible Amps MFA (A): data book
 Dimensions (HxWxD): 11-7/16x41-5/16x9-3/8
 Panel (HxWxD): N/A
 Net Weight (lbs): 26.5
 Weight with Panel (lbs): _____

Airflow Rate (CFM wet coil) 519/436/353
 Moisture Removal (pt/h): 3.4
 Gas Pipe Connection (inch): 1/2
 Liquid Pipe Connection (inch): 1/4
 Condensate Connection (inch): 11/16
 Sound Pressure Level (dBA): 45
 Sound Power Level (dBA): _____


Appearance - Indoor Unit



Project Name: _____
Location: _____
Engineer: _____
Submitted to: _____
Submitted by: _____
Reference: _____

Approval: _____
Date: _____
Construction: _____
Unit #: _____
Drawing #: _____

Dimensional Drawing - Indoor Unit

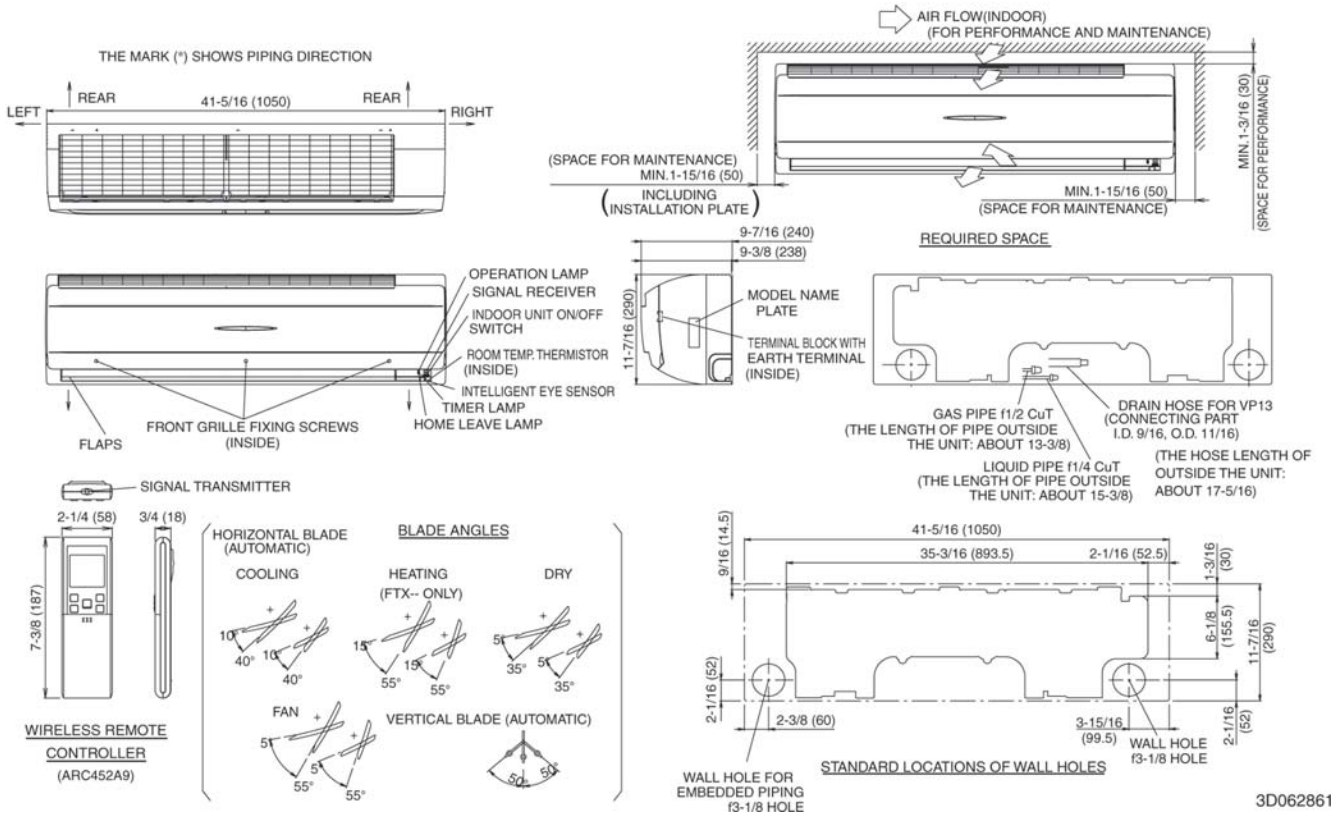

Project Name: _____
Location: _____
Engineer: _____
Submitted to: _____
Submitted by: _____
Reference: _____

Approval: _____
Date: _____
Construction: _____
Unit #: _____
Drawing #: _____

Notes

Includes Intelligent Eye occupancy sensor: Options include Wired Remote Controller, Std U.S. Warranty: 5yrs Parts, 1yr Limited Labor